


WWT FIAL TREATMENT SYSTEM

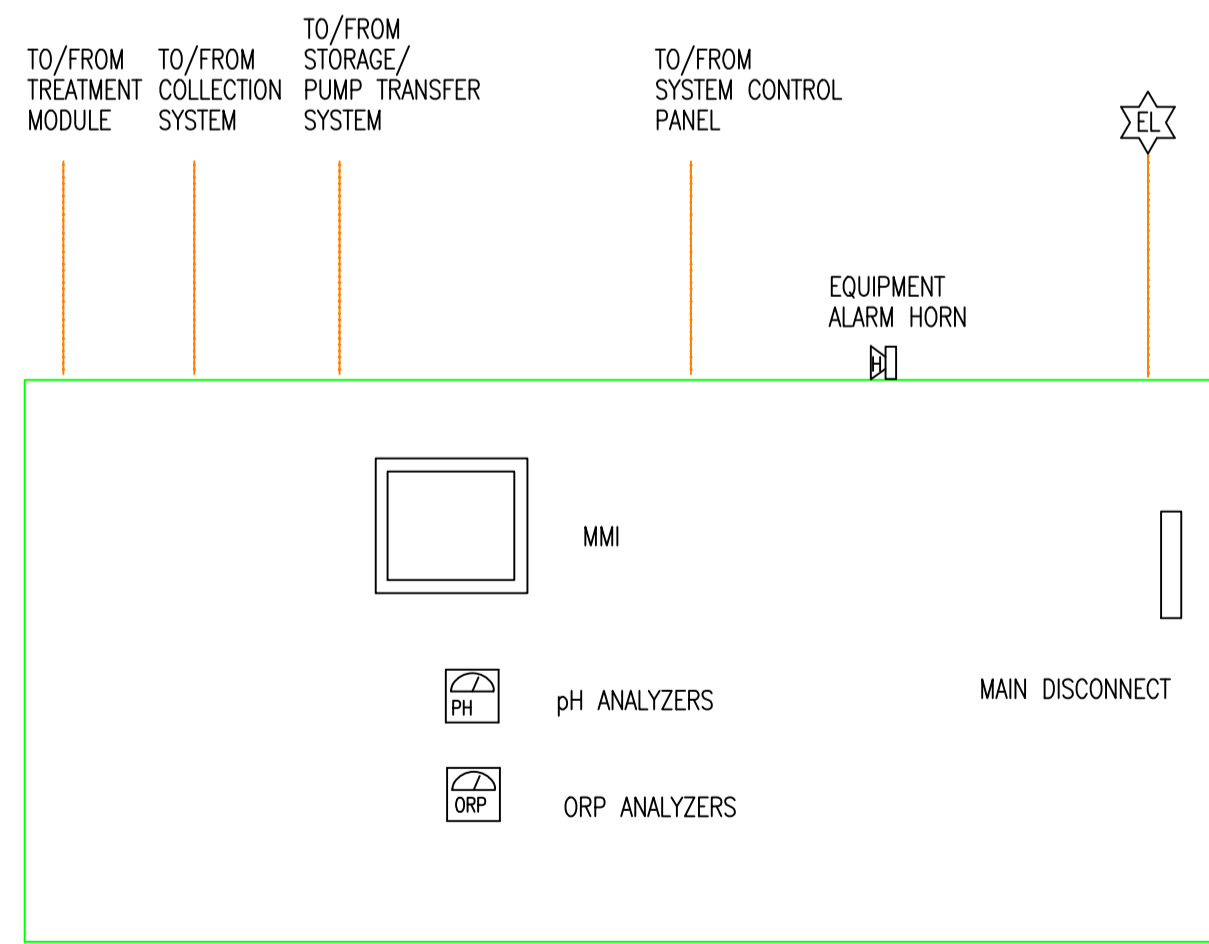

- NOTES:
- SEE SHEET LPID01 FOR SYMBOL LEGEND SHEET
 - SEE SHEET LPIDXX FOR WASTE TRANSFER SYSTEM
 - SEE SHEET LPIDXX FOR TREATMENT MODULE SYSTEM
 - ☒ DESIGNATES COMPRESSED AIR SUPPLY CONNECTION BY CUSTOMER
 - ☒ DESIGNATES PUBLICLY OWNED TREATMENT WORKS CONNECTION BY CUSTOMER
 - ☒ DESIGNATES ELECTRICAL POWER SUPPLY BY CUSTOMER
 - ALL ELECTRICAL DEVICES TO BE WIRED TO WWT CONTROL PANEL BY GKS WIRING CONTRACTOR. SEE THIS SHEET FOR ADDITIONAL INFORMATION
 - ALL SPECIALTY ITEMS SHOWN OUTSIDE OF TANKS FOR PIPING TO BE PROVIDED BY GKS UNLESS NOTED OTHERWISE. PIPE AND FITTINGS OUTSIDE OF TANKS TO BE PROVIDED BY GKS PIPING CONTRACTOR.

NO.	FIRST ISSUE	DATE
		02.01.2019

This drawing and its designs are part of the intellectual property of GEORGE KOCH SONS EUROPE LTD. and may not be copied or used without the written permission of GEORGE KOCH SONS EUROPE LTD. This drawing, its designs and any information hereon may not be disclosed to any third party without the written permission of GEORGE KOCH SONS EUROPE LTD.

KOCH George Koch Sons Europe LTD
A smarter solution. Worldwide.

City House - City Wharf - Davison Road - Lichfield - Staffordshire - WS14 9DZ
Tel : 01543 444001 email : office@kocheurope.com

JOB	TYPICAL P&ID SINGLE HOPPER CLARIFIER PRE-TREATMENT & ELECTRO-COAT LINE	
FOR	JCB CABS	
Drawn by	JMM	Scale NTS
Checked by		Date 02.01.19
Drawing No.	J00270-32-013A	A0

4 January 2019
-- REFERENCE --
John McDonnell